

# North Dundas Drinking Water System

---

Waterworks # 210000728  
System Category – Large Municipal Residential

## Annual Report

Township of North Dundas

Reporting Period of January 1<sup>st</sup> – December 31<sup>st</sup> 2018

Issued: February 20, 2019

Revision: 0

Operating Authority:



This report has been prepared to satisfy the annual reporting requirements in O. Reg. 170/03 Section 11 and Schedule 22

## Table of Contents

<b>Report Availability</b>	<b>1</b>
<b>Compliance Report Card</b>	<b>1</b>
<b>System Process Description</b>	<b>1</b>
Raw Source	1
Treatment	2
Distribution	2
<b>Summary of Non-Compliance</b>	<b>3</b>
Adverse Water Quality Incidents	3
Non-Compliance	3
Non-Compliance Identified in a Ministry Inspection	3
<b>Flows</b>	<b>4</b>
Raw Water Flows	4
Treated Water Flows	10
<b>Regulatory Sample Results Summary</b>	<b>14</b>
Microbiological Testing	14
Operational Testing	14
Inorganic Parameters	14
Organic Parameters	18
Additional Legislated Samples	25
<b>Major Maintenance Summary</b>	<b>25</b>
<b>WTRS Submission Confirmation</b>	<b>A</b>

## Report Availability

As North Dundas' Drinking Water System is considered a large municipal residential system under O. Reg. 170/03, this report must be made available to the public. It can be found at the municipal office located at 636 St. Lawrence Street, Winchester, Ontario and on the Township's website (<https://northdundas.com>).

## Compliance Report Card

Compliance Event	# of Events
Ministry of Environment Inspections	2
Ministry of Labour Inspections	0
QEMS External Audit	1
AWQI's/BWA	0/0
Non-Compliance	0
Spills	0
Watermain Breaks	3

## System Process Description

### Raw Source

North Dundas's Drinking Water System is supplied by a total of eight groundwater production wells located throughout the municipality.

Chesterville Well #5 is a 12.2 m deep drilled groundwater production well equipped with a submersible pump rated at 23 L/sec at 35 m total dynamic head (TDH). The well is located approximately 3.8 km west of Chesterville and 600 m north of Highway 43.

Chesterville Well #6 is a 12.2 m deep drilled groundwater production well equipped with a submersible pump rated at 30.3 L/sec at 34.1 m TDH. The well is located approximately 3.8 km west of Chesterville and 600 m north of Highway 43.

Winchester Well #1 is a 57.9 m deep drilled well equipped with a submersible pump rated at 8.7 L/s at 69.5 m TDH. The well is located in Winchester at the south end of St. Lawrence Street.

Winchester Well #5 is a 28.0 m deep drilled well equipped with a submersible pump rated at 7.6 L/s at 70 m TDH. The well is located west of Winchester, along County Road 31.

Winchester Well #6 is a 15.9 m deep drilled well equipped with a submersible pump rated at 8.3 L/s at 69.5 m TDH. The well is located west of Winchester, along Spruit Road.

Winchester Well Field #7 consists of three gravel packed wells (7a, 7b, 7c), each with a depth of 12-15 m and each equipped with a submersible pump rated at 11.4 L/s at 45 m TDH. The wells are located north east of Winchester along Thompson Road.

### **Treatment**

Sodium hypochlorite is used for both primary and secondary disinfection. Each treatment facility has two chemical feed pumps (one duty and one standby). Water leaving each treatment facility is continuously monitored for flow and free chlorine residual.

### **Distribution**

The distribution systems in both Chesterville and Winchester were originally constructed in 1960. Watermains installed prior to 1973 are composed of asbestos cement, while newer pipes are composed of ductile iron or PVC. The distribution system contains a total of approximately 50 kilometers of distribution piping. Chesterville and Winchester's distribution systems operate independently of one another.

Chesterville's elevated storage tank and reservoir accommodate Chesterville's peak hour demands and fire flows. The elevated tank is fabricated entirely of steel and has a storage capacity of 568 m<sup>3</sup>. The reservoir consists of two equally sized underground cells and a suction well with a total capacity of 530 m<sup>3</sup>.

Winchester's elevated storage tank and reservoir accommodate Winchester's peak hour demands and fire flows. The elevated tank is fabricated of steel and mounted on a concrete pedestal. It has a storage capacity of 2300 m<sup>3</sup>. The reservoir is an on-ground stainless steel baffled tank with an effective capacity of 400 m<sup>3</sup>.

#### **Treatment Chemicals used during the reporting year:**

Chemical Name	Use	Supplier
Sodium Hypochlorite	Disinfection	Brenntag/Jutzi

## Summary of Non-Compliance

### Adverse Water Quality Incidents

Date	AWQI #	Location	Problem	Details	Legislation	Corrective Action Taken
None to report.						

### Non-Compliance

Legislation	requirement(s) system failed to meet	duration of the failure (i.e. date(s))	Corrective Action	Status
None to report.				

### Non-Compliance Identified in a Ministry Inspection

Legislation	requirement(s) system failed to meet	duration of the failure (i.e. date(s))	Corrective Action	Status
None to report.				



## Flows


Raw water flows are regulated under the applicable Permit to Take Water (PTTW).

### Chesterville Well #5 Raw Water Flows

Raw flow data for 2018 was submitted to the Ministry electronically under Permit #3380-AC3QF9. The confirmation can be found attached in Appendix A.


#### Chesterville Well #5 - Flows

Max. Allowable Flow - PTTW

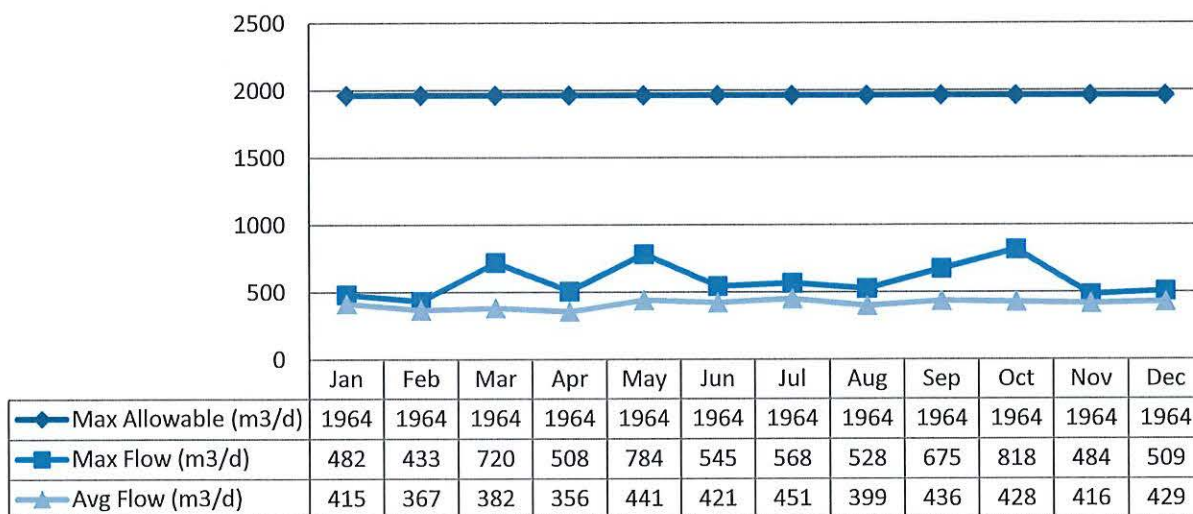

#### Chesterville Well #5 - Maximum Flow Rates

Max. Allowable Rate - PTTW

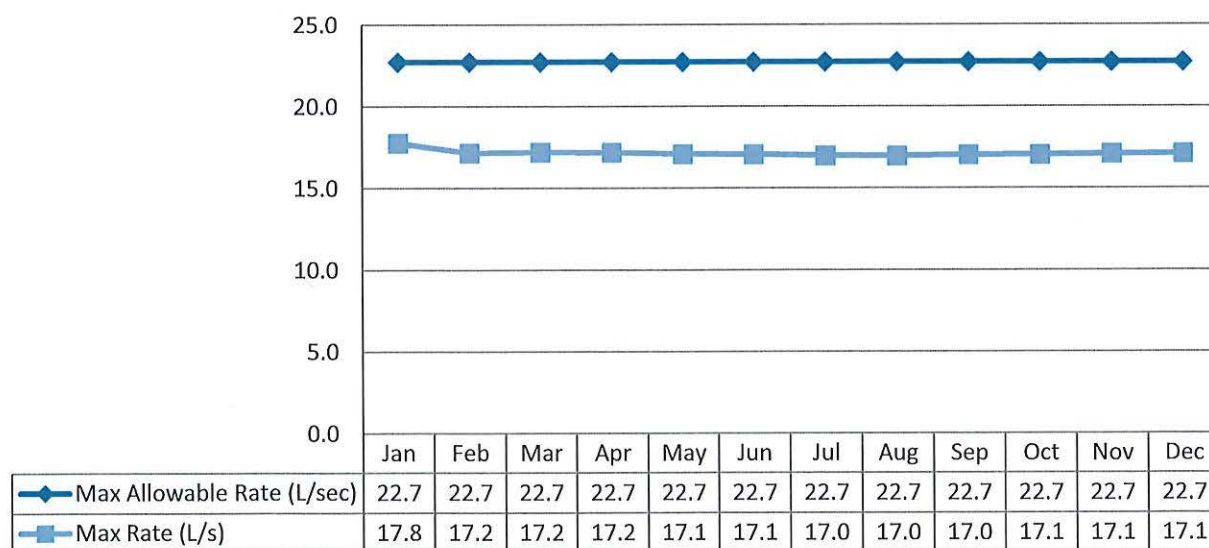


**Chesterville Well #6 Raw Water Flows**


Raw flow data for 2018 was submitted to the Ministry electronically under Permit #3380-AC3QF9. The confirmation can be found attached in Appendix A.

**Chesterville Well #6 - Flows**

Max. Allowable Flow - PTTW

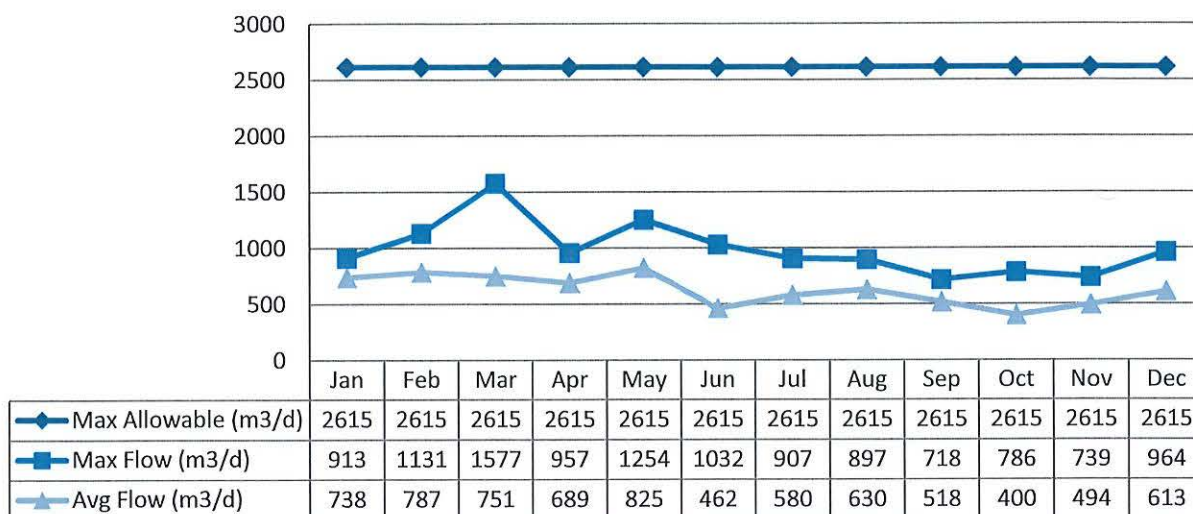**Chesterville Well #6 - Maximum Flow Rates**

Max. Allowable Rate - PTTW

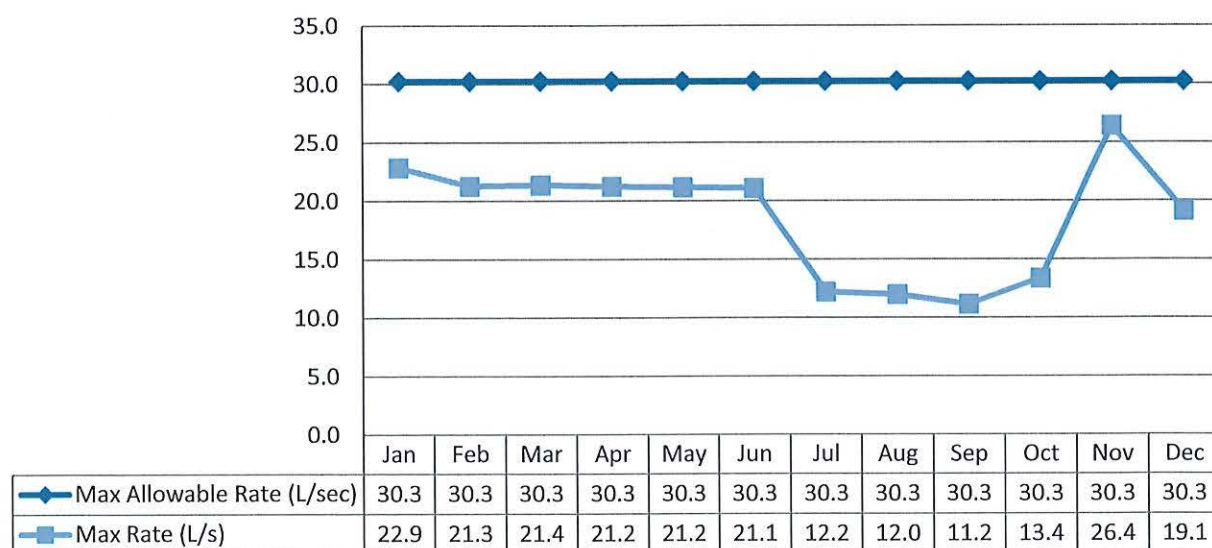


**Winchester Well #1 Raw Water Flows**


Raw flow data for 2018 was submitted to the Ministry electronically under Permit #4175-9C3GPW. The confirmation can be found attached in Appendix A.

**Winchester Well #1 - Flows**

Max. Allowable Flow - PTTW

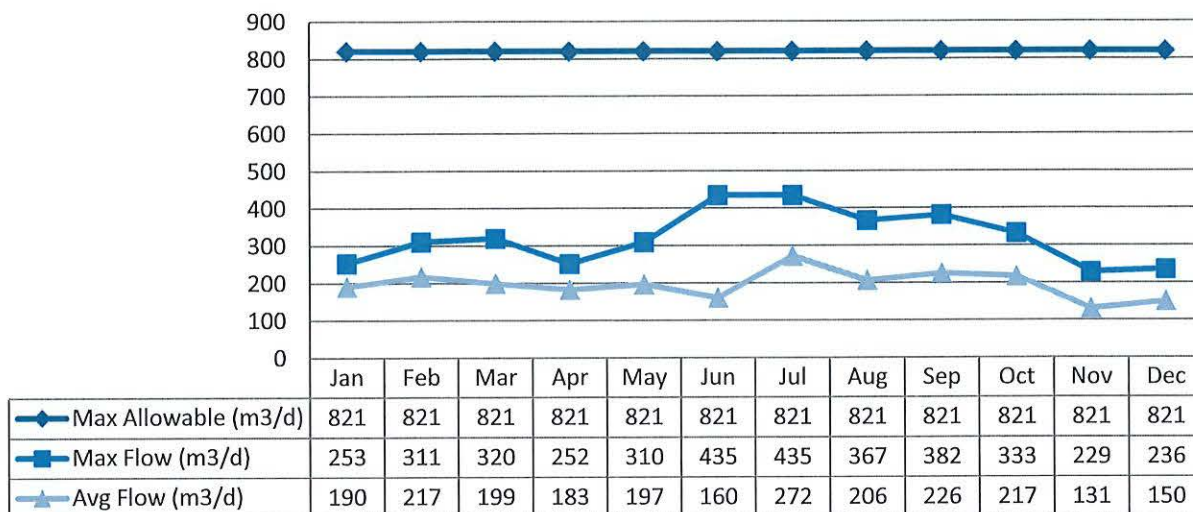**Winchester Well #1 - Maximum Flow Rates**

Max. Allowable Rate - PTTW

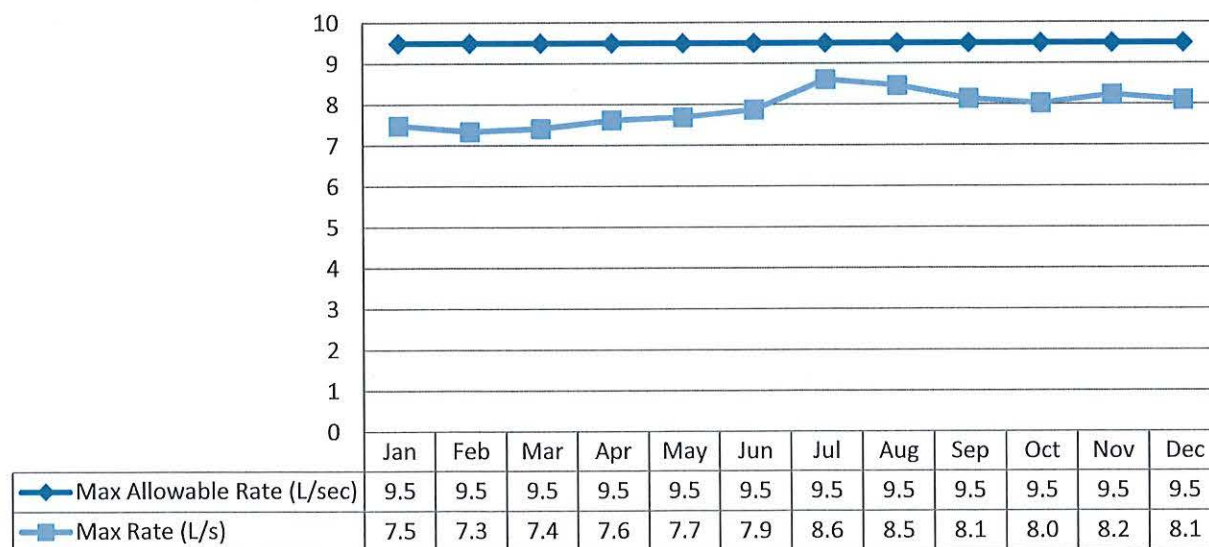




**Winchester Well #5 Raw Water Flows**


Raw flow data for 2018 was submitted to the Ministry electronically under Permit #2181-838S8E. The confirmation can be found attached in Appendix A.

**Winchester Well #5 - Flows**

Max. Allowable Flow - PTTW

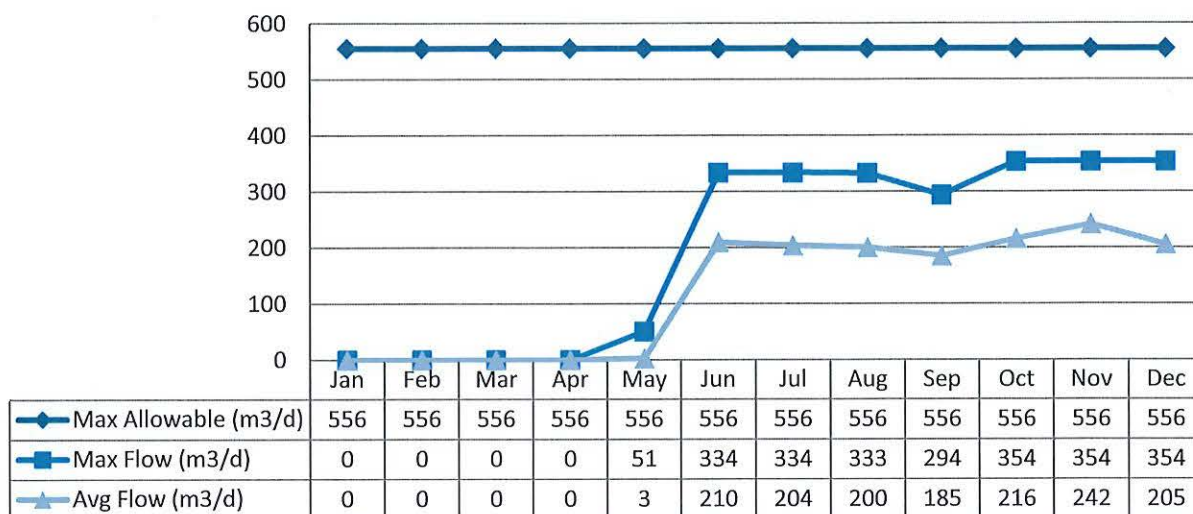**Winchester Well #5 - Maximum Flow Rates**

Max. Allowable Rate - PTTW

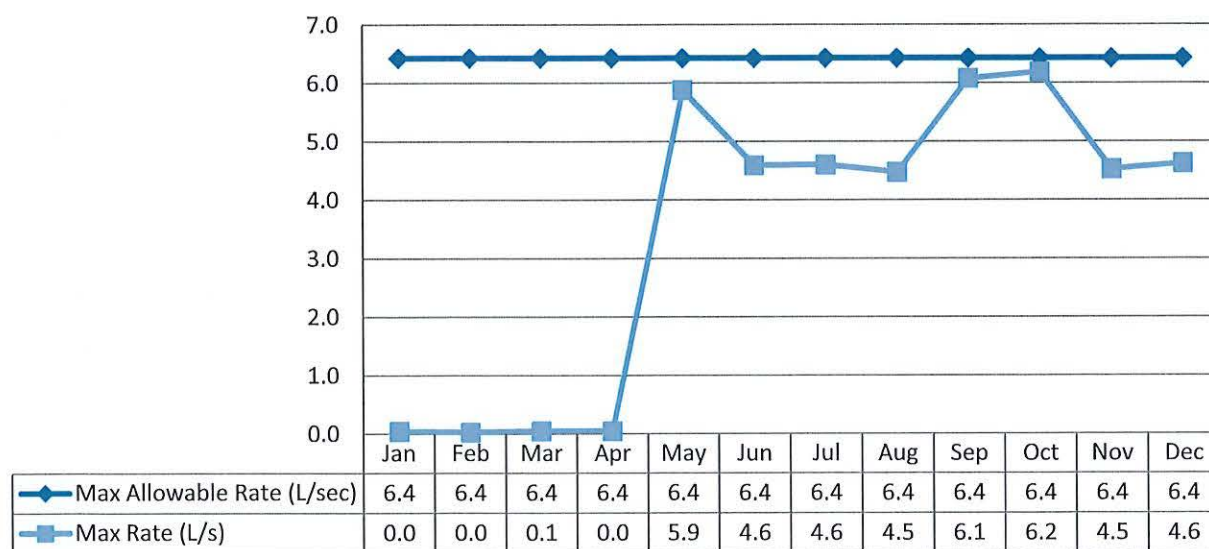


*\*Note: Well #5 was offline for maintenance for the first few months of 2018.*

### Winchester Well #6 Raw Water Flows

Raw flow data for 2018 was submitted to the Ministry electronically under Permit #0088-9C3JG4. The confirmation can be found attached in Appendix A.


#### Winchester Well #6 - Flows

Max. Allowable Flow - PTTW

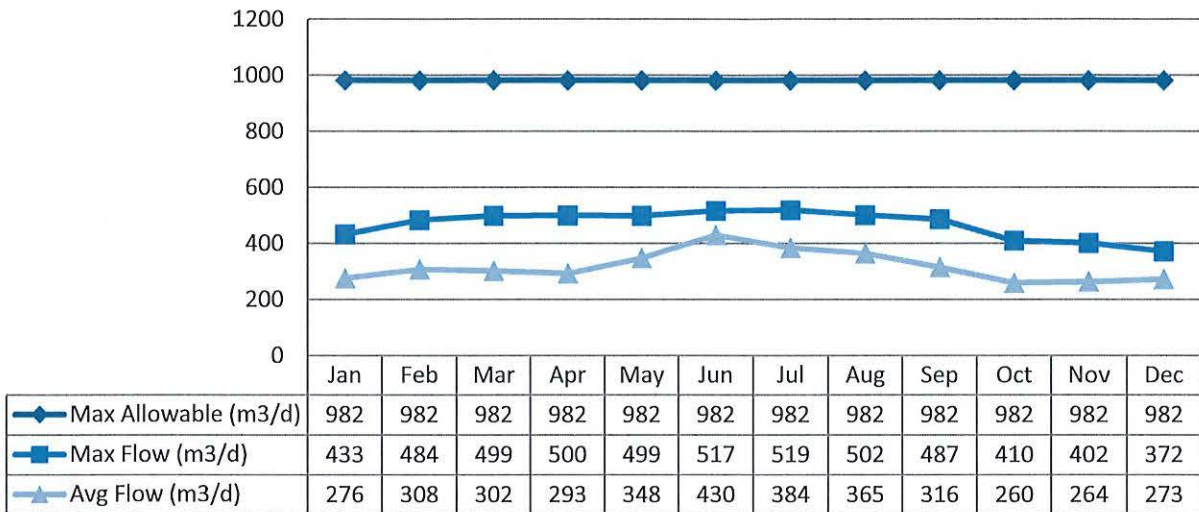

#### Winchester Well #6 - Maximum Flow Rates

Max. Allowable Rate - PTTW

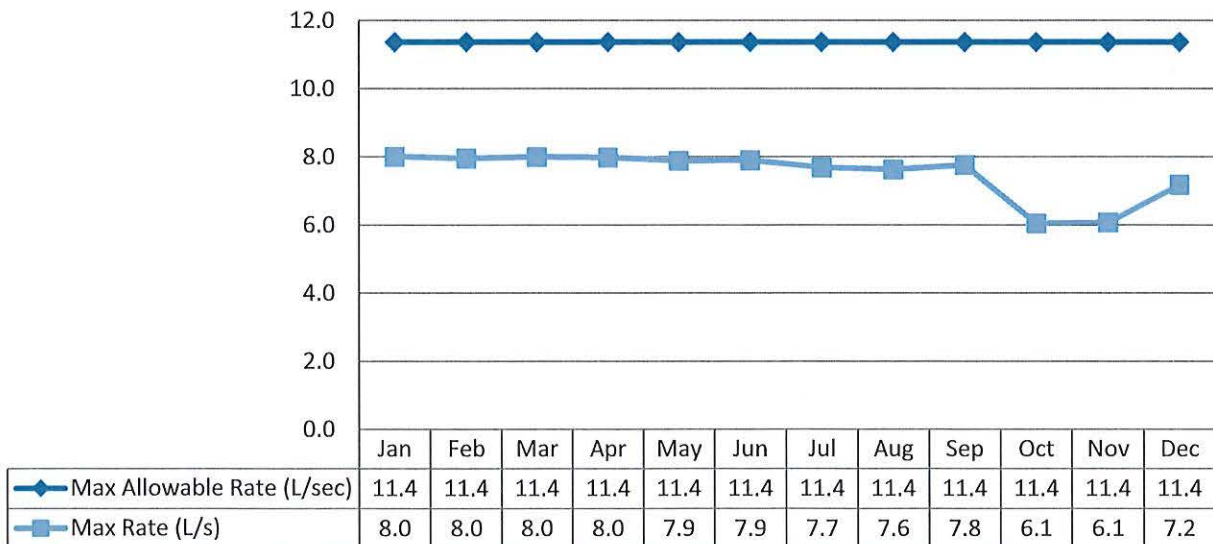


**Well Field #7 Raw Water Flows**


Raw flow data for 2018 was submitted to the Ministry electronically under Permit #0816-838SXR. The confirmation can be found attached in Appendix A.

**Winchester Well Field #7 - Flows**

Max. Allowable Flow - PTTW

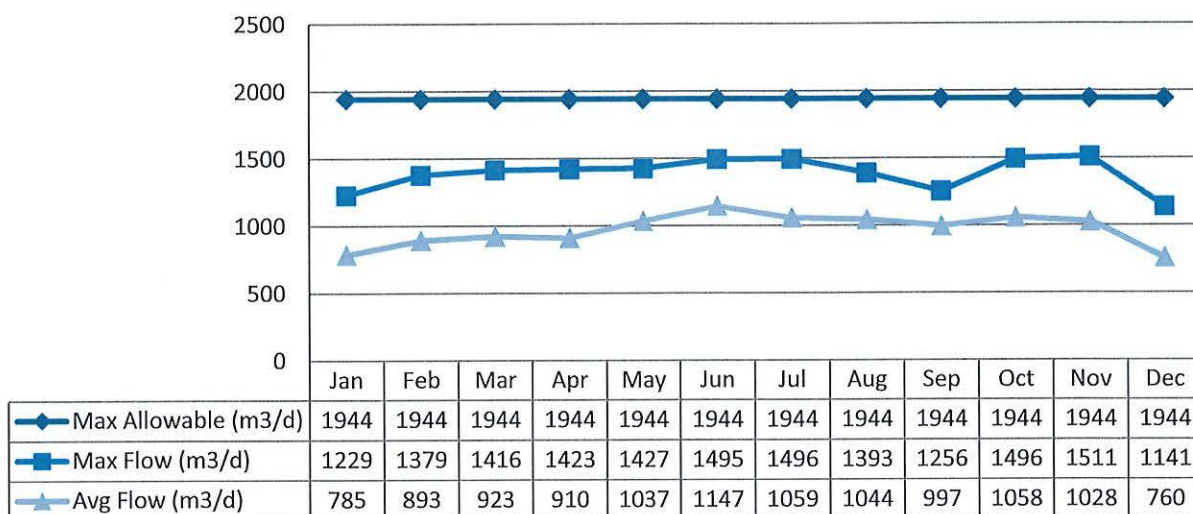**Winchester Well Field #7 - Maximum Flow Rates**

Max. Allowable Rate - PTTW

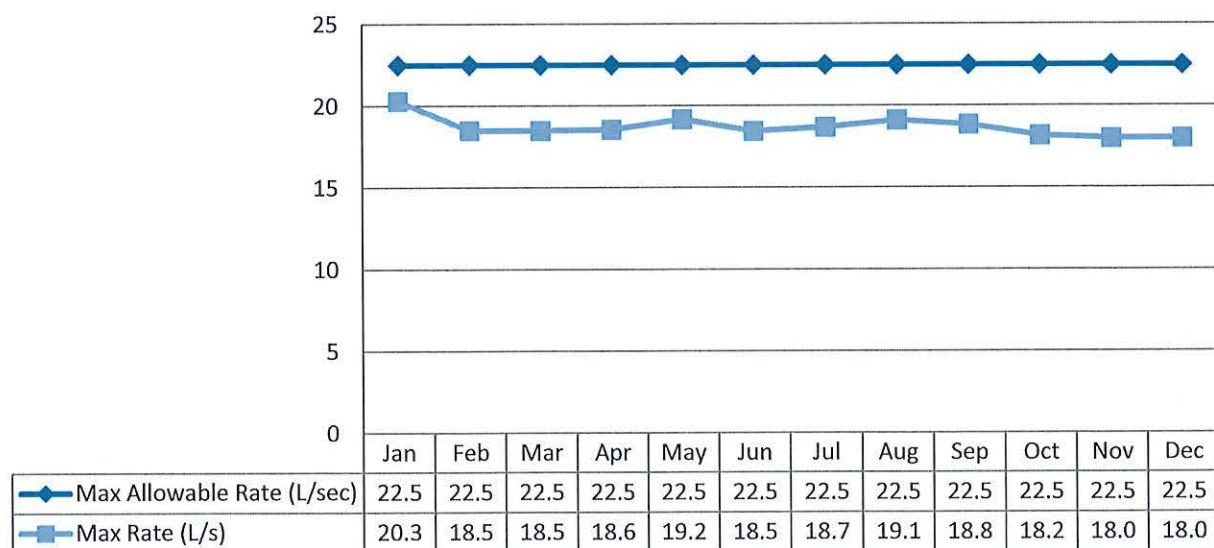


## Treated Water Flows

Treated water flows are regulated under the Municipal Drinking Water Licence (MDWL).


### Chesterville Reservoir - Daily Treated Flows

Rated Capacity - MDWL

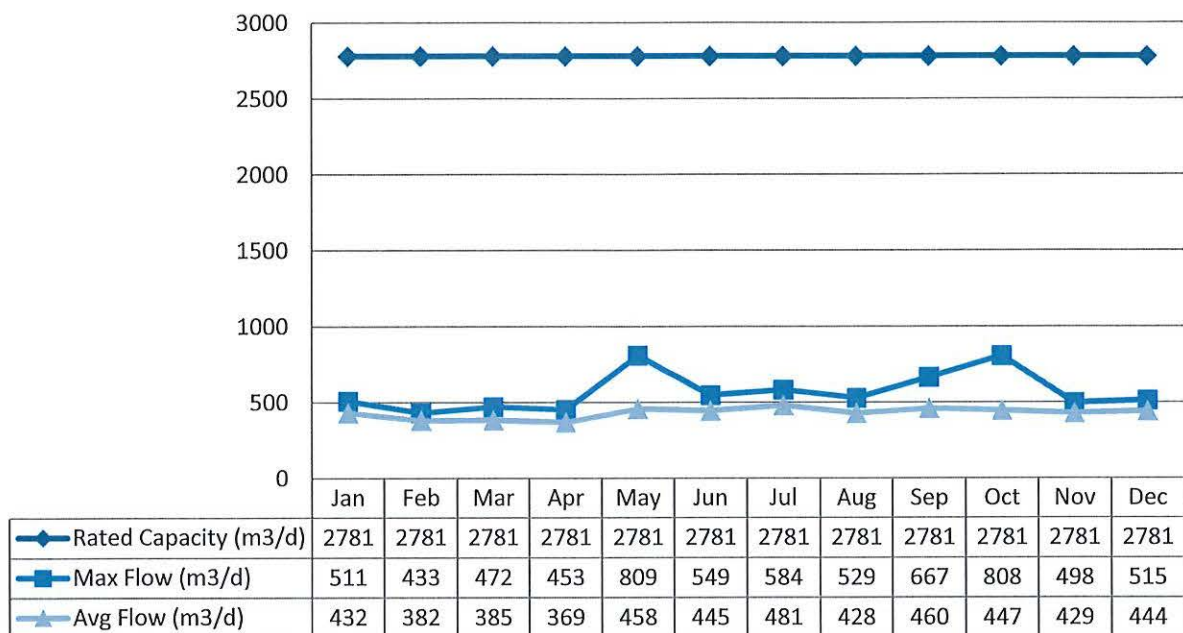

### Winchester Reservoir - Treated Flows


Rated Capacity - MDWL

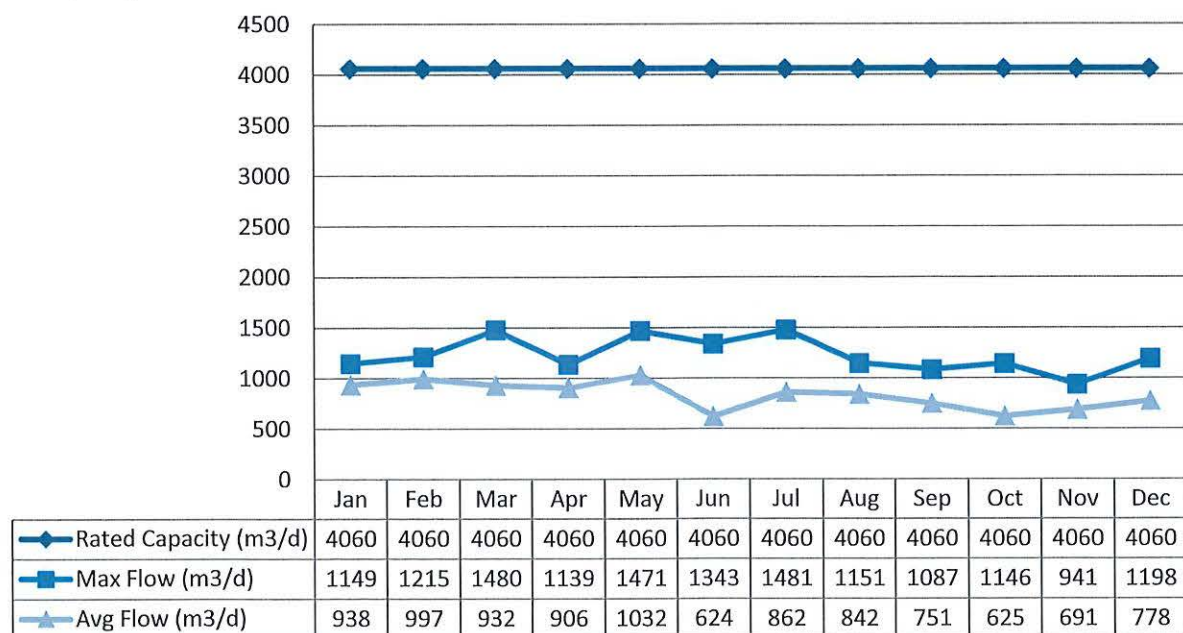




Winchester Well #5 - Treated Flows

Rated Capacity - MDWL


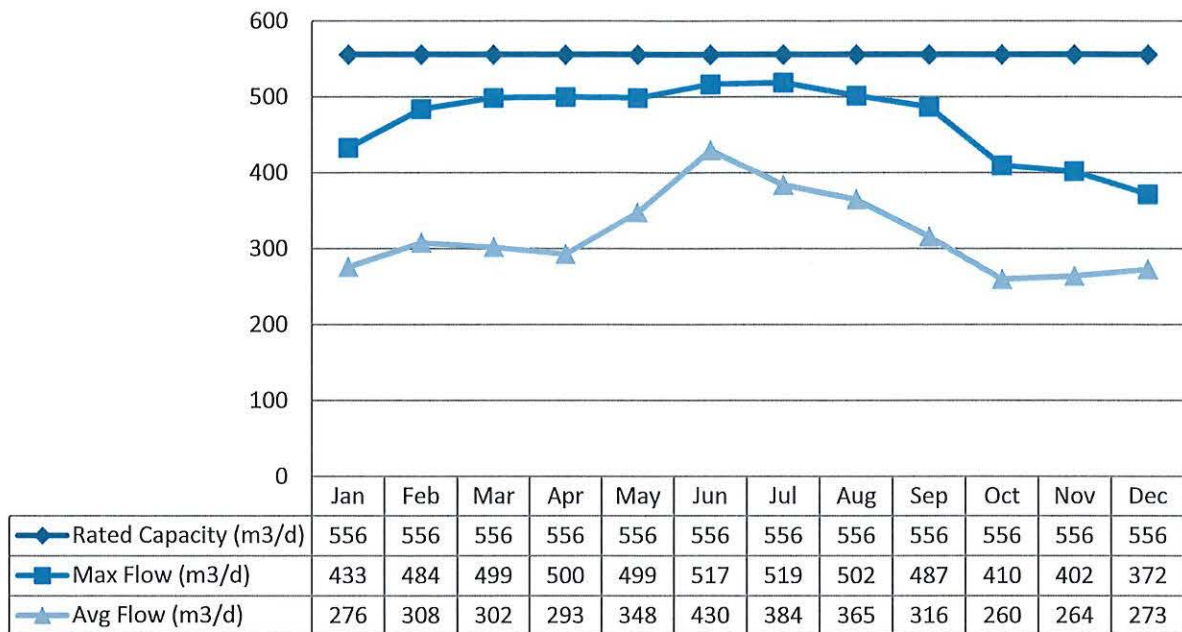
Winchester Well #6 - Treated Flows



Rated Capacity - MDWL

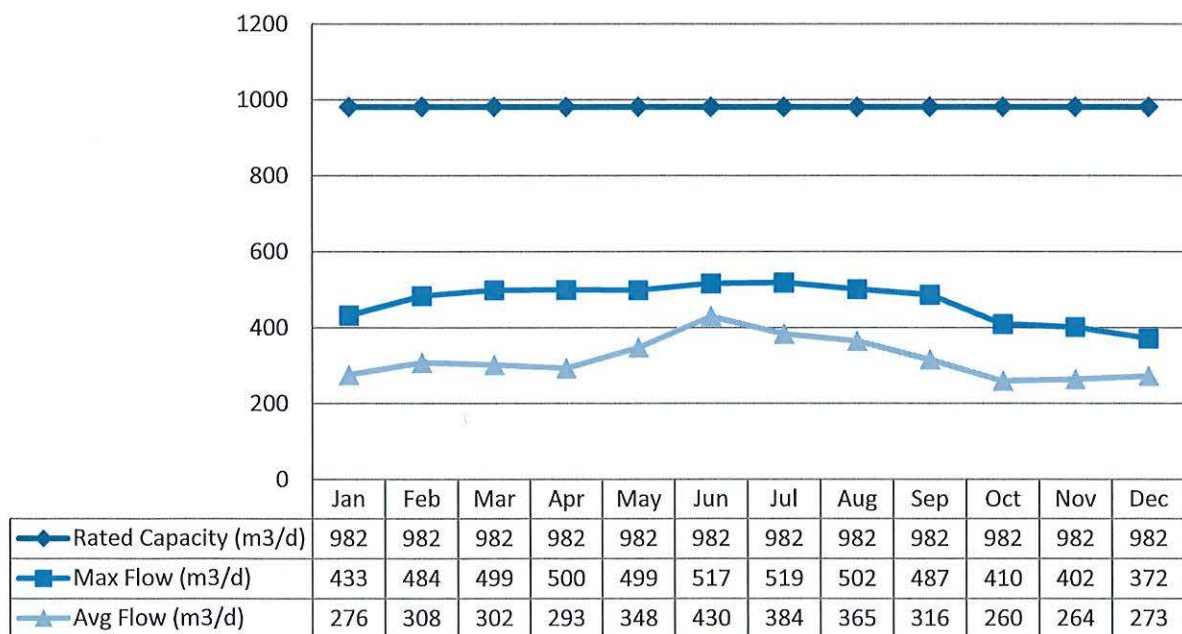

Winchester Well Field #7 - Treated Flows

## Rated Capacity - MDWL

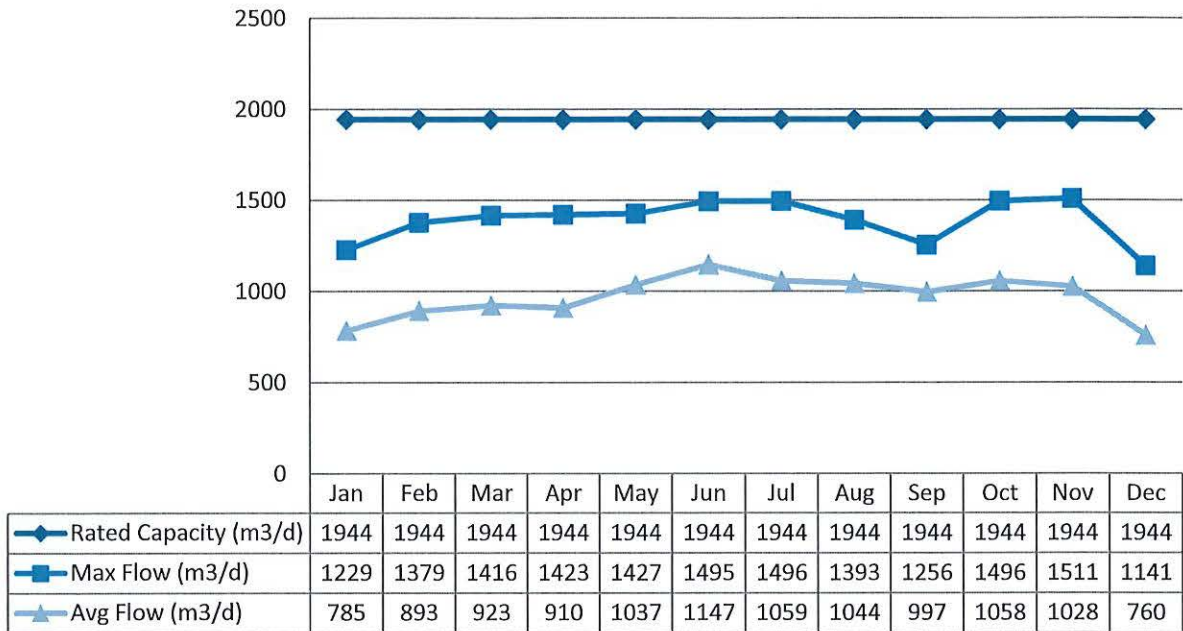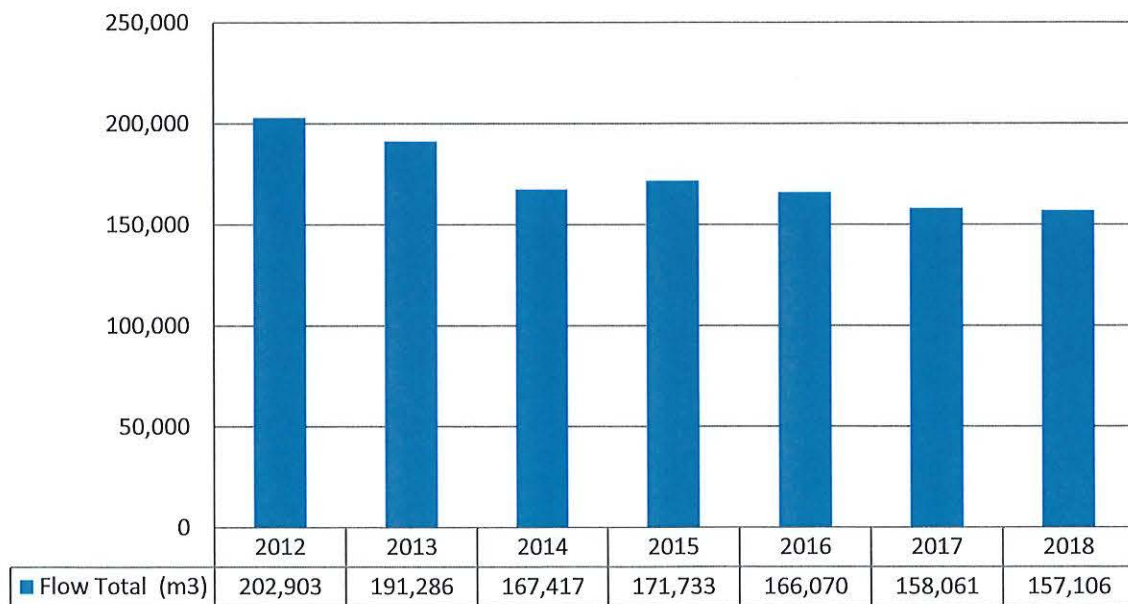Chesterville DWS - Annual Total Flow Comparison

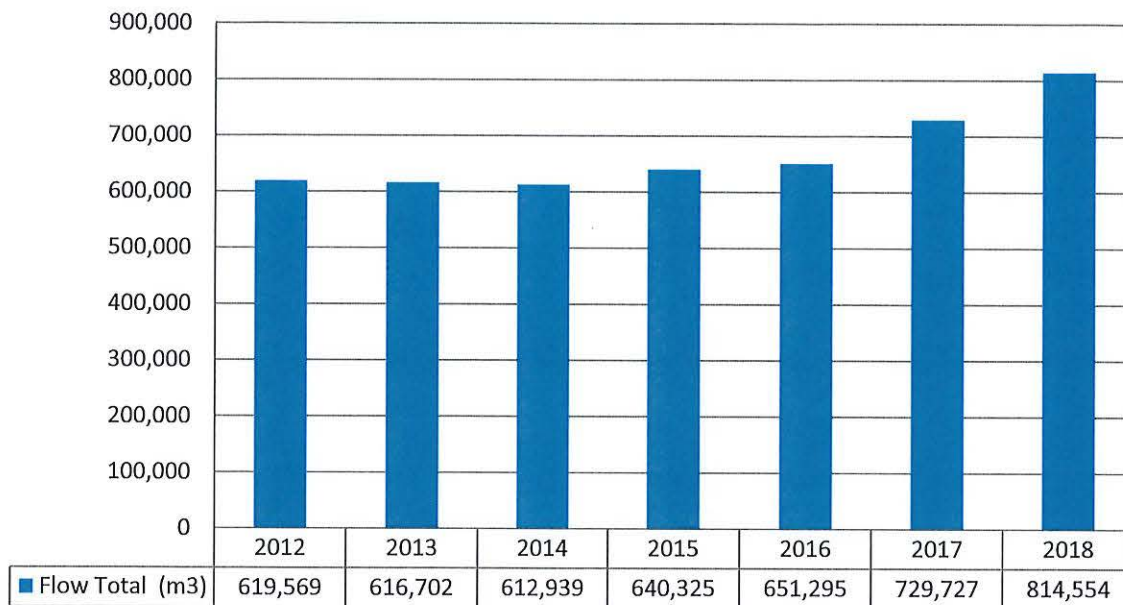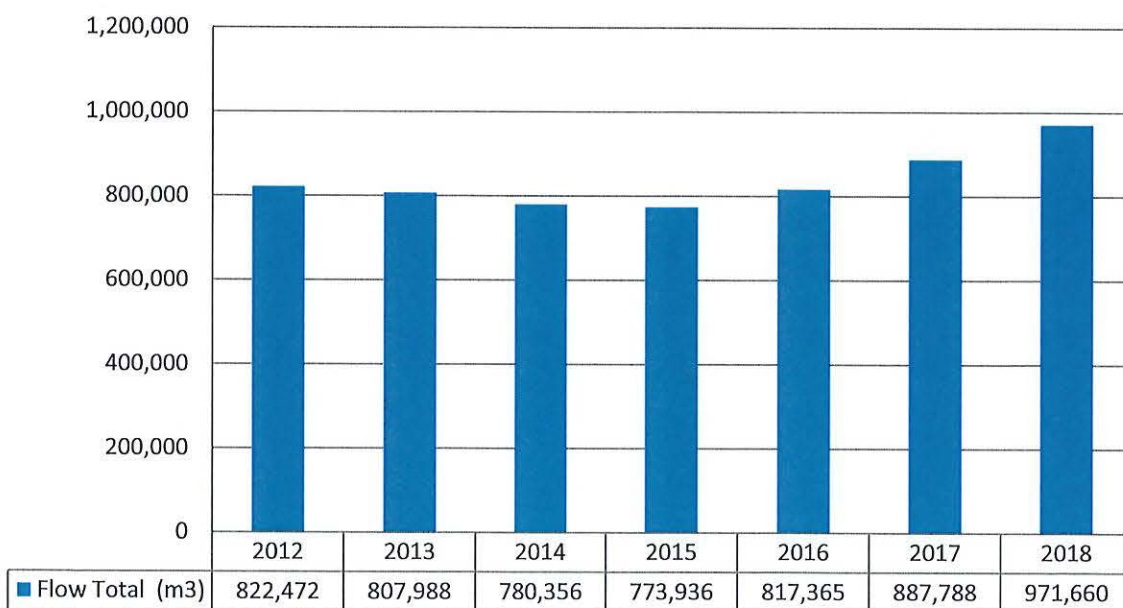Winchester DWS - Annual Total Flow ComparisonNorth Dundas DWS - Annual Total Flow Comparison



## Regulatory Sample Results Summary

### Microbiological Testing

	No. of Samples Collected	Range of E.Coli Results		Range of Total Coliform Results		Range of HPC Results	
		Min	Max	Min	Max	Min	Max
Raw Water	393	0	0	0	7	n/a	n/a
Treated Water	238	0	0	0	0	0	145
Distribution Water	209	0	0	0	0	0	800

### Operational Testing

	No. of Samples Collected	Range of Results	
		Minimum	Maximum
Turbidity, In-House (NTU) - RW1 (WW1)	12	0.15	0.39
Turbidity, In-House (NTU) - RW2 (WW5)	8	0.10	0.33
Turbidity, In-House (NTU) - RW3 (WW6)	12	0.10	0.21
Turbidity, In-House (NTU) - RW4 (WW7A)	12	0.19	0.57
Turbidity, In-House (NTU) - RW5 (WW7B)	12	0.09	0.32
Turbidity, In-House (NTU) - RW6 (WW7C)	12	0.15	0.37
Turbidity, In-House (NTU) - RW8 (CW5)	12	0.10	0.46
Turbidity, In-House (NTU) - RW9 (CW6)	12	0.09	0.55
Free Chlorine Residual, On-Line (mg/L) - TW1 (WW1)	8760	0.76	2.45
Free Chlorine Residual, On-Line (mg/L) - TW2 (WW5)	8760	0.65	3.06
Free Chlorine Residual, On-Line (mg/L) - TW3 (WW6)	8760	0.51	5.00
Free Chlorine Residual, On-Line (mg/L) - TW4 (WWRes)	8760	0.52	3.10
Free Chlorine Residual, On-Line (mg/L) - TW5 (CWRes)	8760	0.47	5.00
Free Chlorine Residual, On-Line (mg/L) - DW1 (WW)	8760	0.44	2.40
Free Chlorine Residual, On-Line (mg/L) - DW3 (CW)	8760	0.55	1.80
Free Chlorine Residual, In-House (mg/L) - DW1 (WW)	52	0.82	1.79
Free Chlorine Residual, In-House (mg/L) - DW2 (WW)	52	0.86	1.86
Free Chlorine Residual, In-House (mg/L) - DW3 (CW)	52	0.60	1.45
Free Chlorine Residual, In-House (mg/L) - DW4 (CW)	52	0.80	1.57

NOTE: Spikes recorded by on-line instrumentation may result from air bubbles and various maintenance/calibration activities. All spikes are reviewed for compliance with O. Reg. 170/03.

### Inorganic Parameters

These parameters are tested as a requirement under O. Reg. 170/03. Sodium and Fluoride are required to be tested every 60 months. Nitrate and Nitrite are tested quarterly and metals are tested every 36 months as required under O. Reg. 170/03. In the event any parameter exceeds half the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg. 169/03
- MDL = Below the laboratory detection level



*\*Note: There is no "MAC" for Sodium. The aesthetic objective for sodium in drinking water is 200 mg/L. The local Medical Officer of Health should be notified when the sodium concentration exceeds 20 mg/L so that this information may be communicated to local physicians for their use with patients on sodium restricted diets.*

### Chesterville Reservoir

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2018/01/22	0.09	6.0	No	No
Arsenic: As (ug/L) - TW	2018/01/22	1.1	10.0	No	No
Barium: Ba (ug/L) - TW	2018/01/22	131	1000.0	No	No
Boron: B (ug/L) - TW	2018/01/22	14	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2018/01/22	0.008	5.0	No	No
Chromium: Cr (ug/L) - TW	2018/01/22	0.10	50.0	No	No
Mercury: Hg (ug/L) - TW	2018/01/22	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2018/01/22	<MDL 0.04	50.0	No	No
Uranium: U (ug/L) - TW	2018/01/22	0.582	20.0	No	No
Additional Inorganics					
Fluoride (mg/L) - TW	2017/01/30	0.06	1.5	No	No
Nitrite (mg/L) - TW	2018/01/22	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/04/09	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/07/30	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/10/09	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2018/01/22	<MDL 0.006	10.0	No	No
Nitrate (mg/L) - TW	2018/04/09	<MDL 0.006	10.0	No	No
Nitrate (mg/L) - TW	2018/07/30	<MDL 0.006	10.0	No	No
Nitrate (mg/L) - TW	2018/10/09	0.020	10.0	No	No
Sodium: Na (mg/L) - TW	2017/02/06	33.4	20*	n/a	n/a

### Winchester Reservoir

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2018/02/01	<MDL 0.02	6.0	No	No
Arsenic: As (ug/L) - TW	2018/02/01	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2018/02/01	112	1000.0	No	No
Boron: B (ug/L) - TW	2018/02/01	250	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2018/02/01	<MDL 0.003	5.0	No	No
Chromium: Cr (ug/L) - TW	2018/02/01	0.11	50.0	No	No
Mercury: Hg (ug/L) - TW	2018/02/01	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2018/02/01	<MDL 0.04	50.0	No	No
Uranium: U (ug/L) - TW	2018/02/01	0.526	20.0	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Additional Inorganics					
Fluoride (mg/L) - TW	2017/02/06	0.14	1.5	No	No
Nitrite (mg/L) - TW	2018/02/01	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/04/09	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/07/04	<MDL 0.10	1.0	No	No
Nitrite (mg/L) - TW	2018/10/01	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2018/02/01	0.044	10.0	No	No
Nitrate (mg/L) - TW	2018/04/09	0.065	10.0	No	No
Nitrate (mg/L) - TW	2018/07/04	<MDL 0.10	10.0	No	No
Nitrate (mg/L) - TW	2018/10/01	0.014	10.0	No	No
Sodium: Na (mg/L) - TW	2017/02/21	38.8	20*	n/a	n/a

**Winchester Well #5**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2018/06/11	<MDL 0.02	6.0	No	No
Arsenic: As (ug/L) - TW	2018/06/11	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2018/06/11	99.7	1000.0	No	No
Boron: B (ug/L) - TW	2018/06/11	724	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2018/06/11	<MDL 0.003	5.0	No	No
Chromium: Cr (ug/L) - TW	2018/06/11	0.11	50.0	No	No
Mercury: Hg (ug/L) - TW	2018/06/11	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2018/06/11	<MDL 0.04	50.0	No	No
Uranium: U (ug/L) - TW	2018/06/11	0.047	20.0	No	No
Additional Inorganics					
Fluoride (mg/L) - TW	2017/02/06	0.28	1.5	No	No
Nitrite (mg/L) - TW	2018/06/11	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/07/04	<MDL 0.10	1.0	No	No
Nitrite (mg/L) - TW	2018/10/01	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2018/06/11	0.011	10.0	No	No
Nitrate (mg/L) - TW	2018/07/04	<0.10	10.0	No	No
Nitrate (mg/L) - TW	2018/10/01	<MDL 0.555	10.0	No	No
Sodium: Na (mg/L) - TW	2017/02/21	114	20*	n/a	n/a

**Winchester Well #6**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2018/02/01	<MDL 0.02	6.0	No	No
Arsenic: As (ug/L) - TW	2018/02/01	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2018/02/01	59.8	1000.0	No	No



	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Boron: B (ug/L) - TW	2018/02/01	143	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2018/02/01	<MDL 0.003	5.0	No	No
Chromium: Cr (ug/L) - TW	2018/02/01	0.09	50.0	No	No
Mercury: Hg (ug/L) - TW	2018/02/01	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2018/02/01	<MDL 0.04	50.0	No	No
Uranium: U (ug/L) - TW	2018/02/01	1.26	20.0	No	No
<b>Additional Inorganics</b>					
Fluoride (mg/L) - TW	2017/02/06	0.26	1.5	No	No
Nitrite (mg/L) - TW	2018/02/01	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/04/09	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/07/04	<MDL 0.10	1.0	No	No
Nitrite (mg/L) - TW	2018/10/01	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2018/02/01	0.214	10.0	No	No
Nitrate (mg/L) - TW	2018/04/09	0.065	10.0	No	No
Nitrate (mg/L) - TW	2018/07/04	0.17	10.0	No	No
Nitrate (mg/L) - TW	2018/10/01	<MDL 0.006	10.0	No	No
Sodium: Na (mg/L) - TW	2017/02/06	16.8	20*	n/a	n/a

**Winchester Well Field #7**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Treated Water					
Antimony: Sb (ug/L) - TW	2018/02/01	<MDL 0.02	6.0	No	No
Arsenic: As (ug/L) - TW	2018/02/01	<MDL 0.2	10.0	No	No
Barium: Ba (ug/L) - TW	2018/02/01	143	1000.0	No	No
Boron: B (ug/L) - TW	2018/02/01	31	5000.0	No	No
Cadmium: Cd (ug/L) - TW	2018/02/01	0.003	5.0	No	No
Chromium: Cr (ug/L) - TW	2018/02/01	0.09	50.0	No	No
Mercury: Hg (ug/L) - TW	2018/02/01	<MDL 0.01	1.0	No	No
Selenium: Se (ug/L) - TW	2018/02/01	0.05	50.0	No	No
Uranium: U (ug/L) - TW	2018/02/01	0.853	20.0	No	No
Additional Inorganics					
Fluoride (mg/L) - TW	2017/02/06	0.09	1.5	No	No
Nitrite (mg/L) - TW	2018/02/01	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/04/09	<MDL 0.003	1.0	No	No
Nitrite (mg/L) - TW	2018/07/04	<MDL 0.10	1.0	No	No
Nitrite (mg/L) - TW	2018/10/01	<MDL 0.003	1.0	No	No
Nitrate (mg/L) - TW	2018/02/01	0.162	10.0	No	No
Nitrate (mg/L) - TW	2018/04/09	0.069	10.0	No	No
Nitrate (mg/L) - TW	2018/07/04	0.19	10.0	No	No
Nitrate (mg/L) - TW	2018/10/01	0.22	10.0	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Sodium: Na (mg/L) - TW	2017/02/06	8.42	20*	n/a	n/a

**Schedule 15 Sampling:**

The Schedule 15 Sampling is required under O. Reg. 170/03. This system is under reduced sampling. No plumbing samples were collected.

Distribution System	Number of Sampling Points	Number of Samples	Range of Results		MAC (ug/L)	Number of Exceedances
			Minimum	Maximum		
Alkalinity (mg/L)	8	8	42	294	n/a	n/a
pH	8	8	7.10	8.16	n/a	n/a
Lead (ug/l)	-	-	-	-	10	0

**Organic Parameters**

These parameters are tested every 36 months as a requirement under O. Reg. 170/03. In the event any of the parameters exceed half of the maximum allowable concentration the parameter is required to be sampled quarterly.

- MAC = Maximum Allowable Concentration as per O. Reg. 169/03
- MDL = Below the laboratory detection level

**Chesterville Reservoir**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2018/01/22	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2018/01/22	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2018/01/22	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2018/01/22	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2018/01/22	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2018/01/22	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2018/01/22	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2018/01/22	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2018/01/22	<MDL 0.16	2.00	No	No
Chlorpyrifos (ug/L) - TW	2018/01/22	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2018/01/22	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2018/01/22	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2018/01/22	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2018/01/22	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	900.00	No	No



	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2018/01/22	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2018/01/22	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2018/01/22	<MDL 0.03	20.00	No	No
Diquat (ug/L) - TW	2018/01/22	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2018/01/22	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2018/01/22	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2018/01/22	<MDL 0.02	190.00	No	No
2-Methyl-4-Chlorophenoxyacetic Acid (MCPA) (ug/L) - TW	2018/01/22	<MDL 0.12	100.00	No	No
Metolachlor (ug/L) - TW	2018/01/22	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2018/01/22	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2018/01/22	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2018/01/22	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2018/01/22	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2018/01/22	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2018/01/22	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2018/01/22	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2018/01/22	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2018/01/22	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2018/01/22	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2018/01/22	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2018/01/22	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2018/01/22	<MDL 0.17	1.00	No	No

**Winchester Reservoir**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2018/01/22	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2018/01/22	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2018/01/22	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2018/01/22	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2018/01/22	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2018/01/22	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2018/01/22	<MDL 0.05	90.00	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Carbofuran (ug/L) - TW	2018/01/22	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2018/01/22	<MDL 0.16	2.00	No	No
Chlorpyrifos (ug/L) - TW	2018/01/22	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2018/01/22	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2018/01/22	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2018/01/22	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2018/01/22	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2018/01/22	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2018/01/22	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2018/01/22	<MDL 0.03	20.00	No	No
Diquat (ug/L) - TW	2018/01/22	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2018/01/22	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2018/01/22	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2018/01/22	<MDL 0.02	190.00	No	No
2-Methyl-4-Chlorophenoxyacetic Acid (MCPA) (ug/L) - TW	2018/01/22	<MDL 0.12	100.00	No	No
Metolachlor (ug/L) - TW	2018/01/22	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2018/01/22	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2018/01/22	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2018/01/22	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2018/01/22	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2018/01/22	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2018/01/22	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2018/01/22	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2018/01/22	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2018/01/22	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2018/01/22	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2018/01/22	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2018/01/22	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2018/01/22	<MDL 0.17	1.00	No	No



**Winchester Well #5**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2018/06/11	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2018/06/11	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2018/06/11	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2018/06/11	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2018/06/11	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2018/06/11	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2018/06/11	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2018/06/11	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2018/06/11	<MDL 0.16	2.00	No	No
Chlorpyrifos (ug/L) - TW	2018/06/11	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2018/06/11	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2018/06/11	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2018/06/11	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2018/06/11	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2018/06/11	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2018/06/11	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2018/06/11	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2018/06/11	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2018/06/11	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2018/06/11	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2018/06/11	<MDL 0.03	20.00	No	No
Diquat (ug/L) - TW	2018/06/11	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2018/06/11	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2018/06/11	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2018/06/11	<MDL 0.02	190.00	No	No
2-Methyl-4-Chlorophenoxyacetic Acid (MCPA) (ug/L) - TW	2018/06/11	<MDL 0.12	100.00	No	No
Metolachlor (ug/L) - TW	2018/06/11	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2018/06/11	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2018/06/11	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2018/06/11	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2018/06/11	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2018/06/11	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2018/06/11	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2018/06/11	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2018/06/11	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2018/06/11	<MDL 0.01	10.00	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Terbufos (ug/L) - TW	2018/06/11	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2018/06/11	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2018/06/11	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2018/06/11	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2018/06/11	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2018/06/11	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2018/06/11	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2018/06/11	<MDL 0.17	1.00	No	No

**Winchester Well #6**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2018/01/22	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2018/01/22	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2018/01/22	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2018/01/22	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2018/01/22	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2018/01/22	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2018/01/22	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2018/01/22	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2018/01/22	<MDL 0.16	2.00	No	No
Chlorpyrifos (ug/L) - TW	2018/01/22	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2018/01/22	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2018/01/22	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2018/01/22	<MDL 0.35	5.00	No	No
1,1-Dichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2018/01/22	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2018/01/22	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2018/01/22	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2018/01/22	<MDL 0.03	20.00	No	No
Diquat (ug/L) - TW	2018/01/22	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2018/01/22	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2018/01/22	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2018/01/22	<MDL 0.02	190.00	No	No



	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
2-Methyl-4-Chlorophenoxyacetic Acid (MCPA) (ug/L) - TW	2018/01/22	<MDL 0.12	100.00	No	No
Metolachlor (ug/L) - TW	2018/01/22	0.12	50.00	No	No
Metribuzin (ug/L) - TW	2018/01/22	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2018/01/22	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2018/01/22	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2018/01/22	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2018/01/22	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2018/01/22	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2018/01/22	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2018/01/22	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2018/01/22	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2018/01/22	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2018/01/22	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2018/01/22	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2018/01/22	<MDL 0.17	1.00	No	No

**Winchester Wellfield #7**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
Treated Water					
Alachlor (ug/L) - TW	2018/01/22	<MDL 0.02	5.00	No	No
Atrazine + N-dealkylated metabolites (ug/L) - TW	2018/01/22	<MDL 0.01	5.00	No	No
Azinphos-methyl (ug/L) - TW	2018/01/22	<MDL 0.05	20.00	No	No
Benzene (ug/L) - TW	2018/01/22	<MDL 0.32	1.00	No	No
Benzo(a)pyrene (ug/L) - TW	2018/01/22	<MDL 0.004	0.01	No	No
Bromoxynil (ug/L) - TW	2018/01/22	<MDL 0.33	5.00	No	No
Carbaryl (ug/L) - TW	2018/01/22	<MDL 0.05	90.00	No	No
Carbofuran (ug/L) - TW	2018/01/22	<MDL 0.01	90.00	No	No
Carbon Tetrachloride (ug/L) - TW	2018/01/22	<MDL 0.16	2.00	No	No
Chlorpyrifos (ug/L) - TW	2018/01/22	<MDL 0.02	90.00	No	No
Diazinon (ug/L) - TW	2018/01/22	<MDL 0.02	20.00	No	No
Dicamba (ug/L) - TW	2018/01/22	<MDL 0.2	120.00	No	No
1,2-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.41	200.00	No	No
1,4-Dichlorobenzene (ug/L) - TW	2018/01/22	<MDL 0.36	5.00	No	No
1,2-Dichloroethane (ug/L) - TW	2018/01/22	<MDL 0.35	5.00	No	No

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	Number of Exceedances	
				MAC	1/2 MAC
1,1-Dichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.33	14.00	No	No
Dichloromethane (Methylene Chloride) (ug/L) - TW	2018/01/22	<MDL 0.35	50.00	No	No
2,4-Dichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	900.00	No	No
2,4-Dichlorophenoxy acetic acid (2,4-D) (ug/L) - TW	2018/01/22	<MDL 0.19	100.00	No	No
Diclofop-methyl (ug/L) - TW	2018/01/22	<MDL 0.4	9.00	No	No
Dimethoate (ug/L) - TW	2018/01/22	<MDL 0.03	20.00	No	No
Diquat (ug/L) - TW	2018/01/22	<MDL 1.0	70.00	No	No
Diuron (ug/L) - TW	2018/01/22	<MDL 0.03	150.00	No	No
Glyphosate (ug/L) - TW	2018/01/22	<MDL 1.0	280.00	No	No
Malathion (ug/L) - TW	2018/01/22	<MDL 0.02	190.00	No	No
2-Methyl-4-Chlorophenoxyacetic Acid (MCPA) (ug/L) - TW	2018/01/22	<MDL 0.12	100.00	No	No
Metolachlor (ug/L) - TW	2018/01/22	<MDL 0.01	50.00	No	No
Metribuzin (ug/L) - TW	2018/01/22	<MDL 0.02	80.00	No	No
Monochlorobenzene (Chlorobenzene) (ug/L) - TW	2018/01/22	<MDL 0.3	80.00	No	No
Paraquat (ug/L) - TW	2018/01/22	<MDL 1.0	10.00	No	No
PCB (ug/L) - TW	2018/01/22	<MDL 0.04	3.00	No	No
Pentachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.15	60.00	No	No
Phorate (ug/L) - TW	2018/01/22	<MDL 0.01	2.00	No	No
Picloram (ug/L) - TW	2018/01/22	<MDL 1.0	190.00	No	No
Prometryne (ug/L) - TW	2018/01/22	<MDL 0.03	1.00	No	No
Simazine (ug/L) - TW	2018/01/22	<MDL 0.01	10.00	No	No
Terbufos (ug/L) - TW	2018/01/22	<MDL 0.01	1.00	No	No
Tetrachloroethylene (ug/L) - TW	2018/01/22	<MDL 0.35	10.00	No	No
2,3,4,6-Tetrachlorophenol (ug/L) - TW	2018/01/22	<MDL 0.2	100.00	No	No
Triallate (ug/L) - TW	2018/01/22	<MDL 0.01	230.00	No	No
Trichloroethylene (ug/L) - TW	2018/01/22	<MDL 0.44	5.00	No	No
2,4,6-Trichlorophenol (ug/L) - TW	2018/01/22	<MDL 0.25	5.00	No	No
Trifluralin (ug/L) - TW	2018/01/22	<MDL 0.02	45.00	No	No
Vinyl Chloride (ug/L) - TW	2018/01/22	<MDL 0.17	1.00	No	No

Distribution samples are tested quarterly for THM's and HAA's in accordance with O. Reg. 170/03.

### Chesterville Distribution

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Distribution Water					
Trihalomethane (THM): Total (ug/L) Annual Average - DW	2018/01/01	17.8	100	No	No



Haloacetic Acid (HAA): Total (ug/L) Annual Average - DW	2018/01/01	<5.3	n/a	n/a	n/a
--	------------	------	-----	-----	-----

**Winchester Distribution**

	Sample Date (yyyy/mm/dd)	Sample Result	MAC	No. of Exceedances	
				MAC	1/2 MAC
Distribution Water					
Trihalomethane (THM): Total (ug/L) Annual Average - DW	2018/01/01	34.5	100	No	No
Haloacetic Acid (HAA): Total (ug/L) Annual Average - DW	2018/01/01	9.6	n/a	n/a	n/a

**Additional Legislated Samples**

No additional sampling required.

**Major Maintenance Summary**

Description
<ul style="list-style-type: none"> <li>- Rebuilt 16 fire hydrants</li> <li>- Upgraded radios and SCADAPak at Well #5 and Well #6 (Chesterville)</li> <li>- Rehabilitated Well #6 (Chesterville)</li> <li>- Repaired two watermain breaks along Queen St. and one on Main St. (Chesterville)</li> <li>- Replaced pressure gauge on Well #1 discharge line (Winchester)</li> <li>- Replaced Well #5 pump motor and wiring (Winchester)</li> <li>- Repaired flow meter after lightning strike at Well #5 (Winchester)</li> <li>- Replaced Well #6 flow control valve (Winchester)</li> <li>- Replaced packing on main shut off valve at Well #7 (Winchester)</li> <li>- Replaced alarm dialer keypad at Well #7 and water tower (Winchester)</li> <li>- Replaced sump pump at Reservoir (Winchester)</li> <li>- Replaced generator battery at Well #1 and Reservoir (Winchester)</li> <li>- Repaired damaged hydrant along Highway 31 (Winchester)</li> <li>- Purchased and installed new chlorine pumps (2)</li> <li>- Repaired/replaced curb stops and main valves</li> <li>- Installed cathodic protection</li> <li>- Purchased chlorine pump repair kits</li> </ul>



# Appendix A

---

## WTRS Submission Confirmation



Location: WTRS / WT DATA / Input WT Record

WTRS-WT-008

**Water Taking Data submitted successfully.****Confirmation:**

Thank you for submitting your water taking data online.

Permit Number: 3380-AC3QF9

Permit Holder: THE CORPORATION OF THE TOWNSHIP OF NORTH DUNDAS.

Received on: Jan 22, 2019 2:31 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Return to Main Page](#)

NORTH2 DUNDAS2 | 2019/01/22

version: v4.5.0.21 (build#: 22)

Last modified: 2018/09/18



This site maintained by  
the Government of Ontario

©2019 Queen's Printer for Ontario

*Chesterville*  
*3380-AC3QF9*  
*2018*



Location: WTRS / WT DATA / Input WT Record

WTRS-WT-008

**Water Taking Data submitted successfully.****Confirmation:**

Thank you for submitting your water taking data online.

Permit Number: 4175-9C3GPW

Permit Holder: THE CORPORATION OF THE TOWNSHIP OF NORTH DUNDAS.

Received on: Jan 22, 2019 2:54 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Return to Main Page](#)

NORTH2 DUNDAS2 | 2019/01/22  
version: v4.5.0.21 (build#: 22)  
Last modified: 2018/09/18



This site maintained by  
the Government of Ontario

©2019 Queen's Printer for Ontario

Winchester  
well #1  
4175-9C3GPW  
norB





Location: WTRS / WT DATA / Input WT Record

WTRS-WT-008

**Water Taking Data submitted successfully.****Confirmation:**

Thank you for submitting your water taking data online.

Permit Number: 2181-838S8E

Permit Holder: THE CORPORATION OF THE TOWNSHIP OF NORTH DUNDAS.

Received on: Jan 22, 2019 2:57 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Return to Main Page](#)

NORTH2 DUNDAS2 | 2019/01/22

version: v4.5.0.21 (build#: 22)

Last modified: 2018/09/18



This site maintained by  
the Government of Ontario

©2019 Queen's Printer for Ontario

Winchester  
well #5  
2181-838S8E  
2018



Location: WTRS / WT DATA / Input WT Record

WTRS-WT-008

**Water Taking Data submitted successfully.****Confirmation:**

Thank you for submitting your water taking data online.

Permit Number: 0088-9C3JG4

Permit Holder: THE CORPORATION OF THE TOWNSHIP OF NORTH DUNDAS.

Received on: Jan 22, 2019 2:59 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Return to Main Page](#)

NORTH2 DUNDAS2 | 2019/01/22  
version: v4.5.0.21 (build#: 22)  
Last modified: 2018/09/18



This site maintained by  
the Government of Ontario

©2019 Queen's Printer for Ontario

Winchester  
well #6  
0088-9C3JG4  
2018



Location: WTRS / WT DATA / Input WT Record

WTRS-WT-008

**Water Taking Data submitted successfully.****Confirmation:**

Thank you for submitting your water taking data online.

Permit Number: 0816-838SXR

Permit Holder: THE CORPORATION OF THE TOWNSHIP OF NORTH DUNDAS.

Received on: Jan 22, 2019 3:02 PM

This confirmation indicates that your data has been received by the Ministry, but should not be construed as acceptance of this data if it differs from that specified on the Permit Number, assigned to the Permit Holder stated above.

[Return to Main Page](#)

NORTH2 DUNDAS2 | 2019/01/22

version: v4.5.0.21 (build#: 22)

Last modified: 2018/09/18



This site maintained by  
the Government of Ontario

©2019 Queen's Printer for Ontario

Winchester  
Well #7  
0816-838SXR  
2018